


STANDARD MANHOLE

FOR SEWERS 36" DIA. & SMALLER

EAST JORDON IRON WORKS FRAME & COVER
 MODEL 1975A (NOT VENTED), 1975B (VENTED)
 OR MODEL 1975AGS (NOT VENTED-GAS TIGHT)
 APPROVED EQUAL WITH "SANITARY SEWER"
 CAST INTO LID. PROVIDE SELF SEALING LID FOR
 SANITARY MANHOLE IN PAVEMENT.

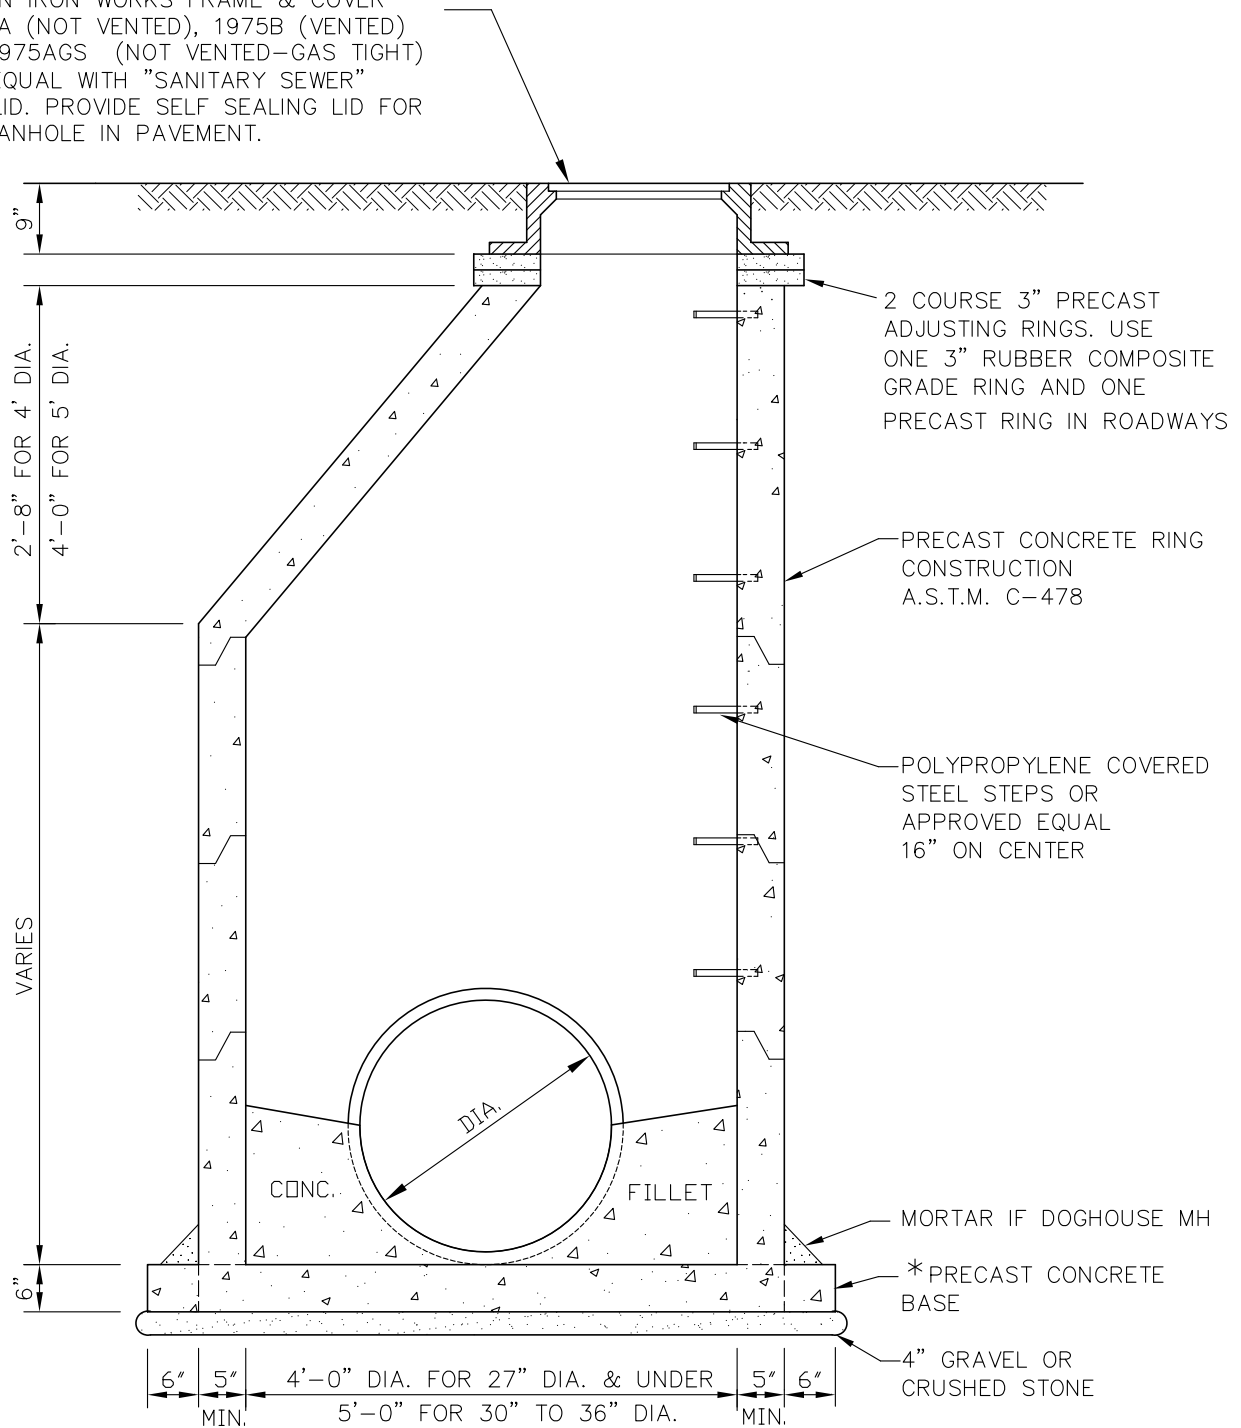

NOTES:

1. WHEN FINISHED GRADE ELEVATION PROHIBITS USE OF CONE, INSTALL FLAT SLAB TOP
2. PIPE OPENINGS TO BE CAST INTO WALL, AND HAVE BOOTS.
3. * IT IS PREFERRED THAT PRECAST CONC. BASE BE CAST INTEGRAL WITH LOWEST WALL SECTION.
4. PRECAST SECTIONS TO BE JOINED WITH TONGUE AND GROOVE JOINTS SEALED WITH MASTIC TYPE BITUMINOUS JOINTING COMPOUND.
5. EXTERIOR OF M.H. TO BE BITUMINOUS COATED.
6. MINIMUM SLOPE THROUGH M.H. SHALL BE 0.1' IN 4' OR 2.50%.
7. MANHOLES WITHIN STATE R/W TO BE PENN DOT APPROVED.
8. MANHOLES SHALL HAVE RUBBERIZED BOOT SEAL (LINK SEAL) OR APPROVED EQUAL.